


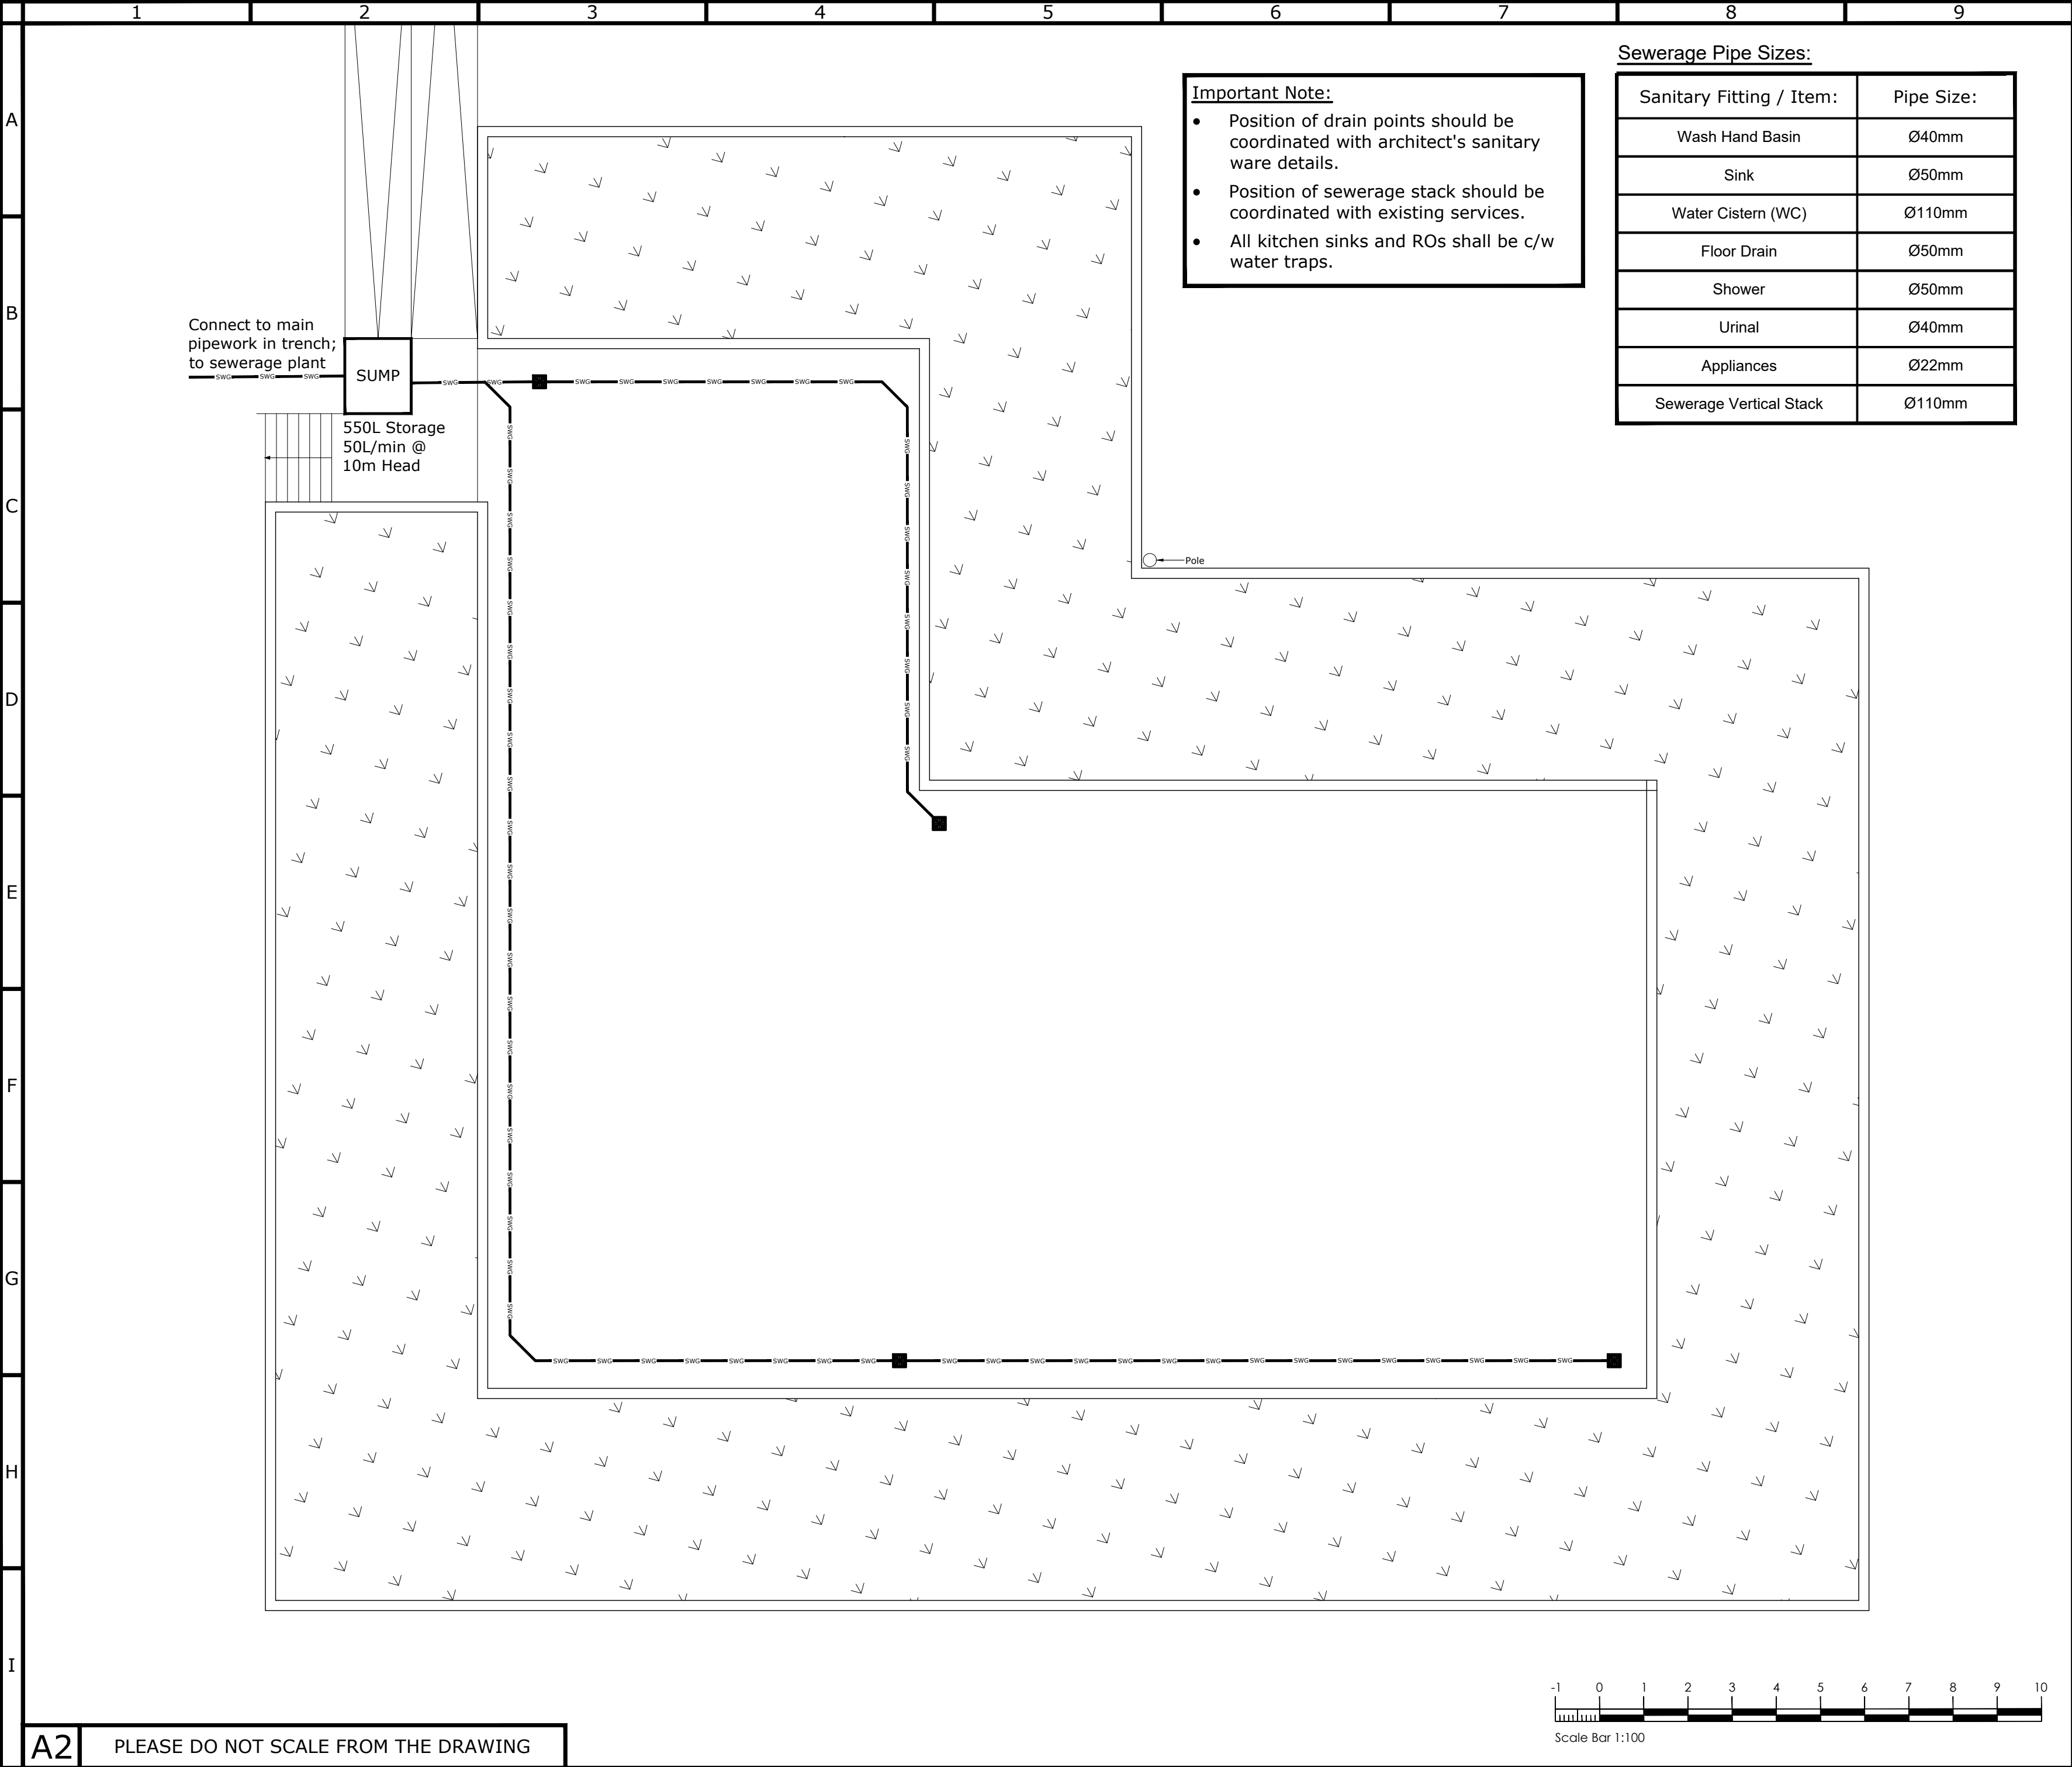

Important Note:

- Position of drain points should be coordinated with architect's sanitary ware details.
- Position of sewerage stack should be coordinated with existing services.
- All kitchen sinks and ROs shall be c/w water traps.

Sewerage Pipe Sizes:

Sanitary Fitting / Item:	Pipe Size:
Wash Hand Basin	Ø40mm
Sink	Ø50mm
Water Cistern (WC)	Ø110mm
Floor Drain	Ø50mm
Shower	Ø50mm
Urinal	Ø40mm
Appliances	Ø22mm
Sewerage Vertical Stack	Ø110mm

General Notes and Legends

Legend:-

— SWG —	Sewerage Pipework
●	Sewerage Stack
●	Rainwater Downdrop
⊠	Gully
○	Wash Hand Basin Connection
⊘	Water Cistern (WC) Connection
⊗	Appliances Connection
⊞	Floor Drain
□	Sink Connection
☑	Shower
☒	Urinal

-	-	-	-
-	-	-	-
-	-	-	-
01	23.09.20	NTA	Revised Layout

CAMILLERI & CUSCHIERI
CONSULTING ENGINEERS
Design Center, Level 2, Tower Road, Swatar,
Birkirkara, Malta BKR 4012
+356 21220431 +356 7220431
info@camilleriandcuschieri.com
www.camilleriandcuschieri.com

40 Years

Project Name & Address:

Nature Trust
Xrobb L-Għagin

THIS DRAWING IS CONFIDENTIAL AND IS THE PROPERTY OF CAMILLERI & CUSCHIERI CONSULTING ENGINEERS. IT MUST NOT BE DISCLOSED TO A THIRD PARTY, COPIED OR LENT, WITHOUT THE WRITTEN CONSENT OF CAMILLERI & CUSCHIERI CONSULTING ENGINEERS.

Scale: 1:100	Revision No.: 01	Date: 26.08.20
-----------------	---------------------	-------------------

Job No.: 20.032	Drawing No.: NT-XG.SWG.AV.01
--------------------	---------------------------------

Drawn By: <i>Nayana Abela</i>	Checked By:
----------------------------------	-------------

Position:
Aviary

Service:
Sewerage Installation Layout

